

ASPHALT SECTION AS SPECIFIED BY CITY STANDARDS.

NOTE:
NATURAL SOIL IS OK WITH DISTRICT APPROVAL.

12" OVER CUT IS REQUIRED WHEN TRENCH IS IN EXISTING PAVEMENT. TACK COAT ALL ASPHALT

NATIVE BACKFILL - 4" MINUS & FREE OF ORGANIC MATTER. TO BE COMPACTED TO 95% MAX. SOIL DENSITY AS DETERMINED BY ASTM D-1557

MARKING TAPE PLACED 12" ABOVE TOP OF PIPE (PRESSURE SEWER ONLY)


14 GAUGE, TYPE UF LOCATE WIRE (PRESSURE SEWER ONLY)

TRENCH SIDES TO MEET OSHA RULES AND REGULATIONS AND OR TRENCH BOX STANDARDS

MINUS NO.4 SIEVE SAND BEDDING WITH LESS THAN 15% FINES COMPACTED TO 95% MAX. DENSITY AS DETERMINED BY ASTM D-1557

1" LOOSELY COMPACTED MINUS NO.4 SIEVE SAND BEDDING WITH MORE THAN 15% FINES

FOUNDATION MATERIAL SHALL BE USED AS SPECIFIED BY THE GEOTECHNICAL ENGINEER WHEN TRENCH BOTTOM IS UNSTABLE

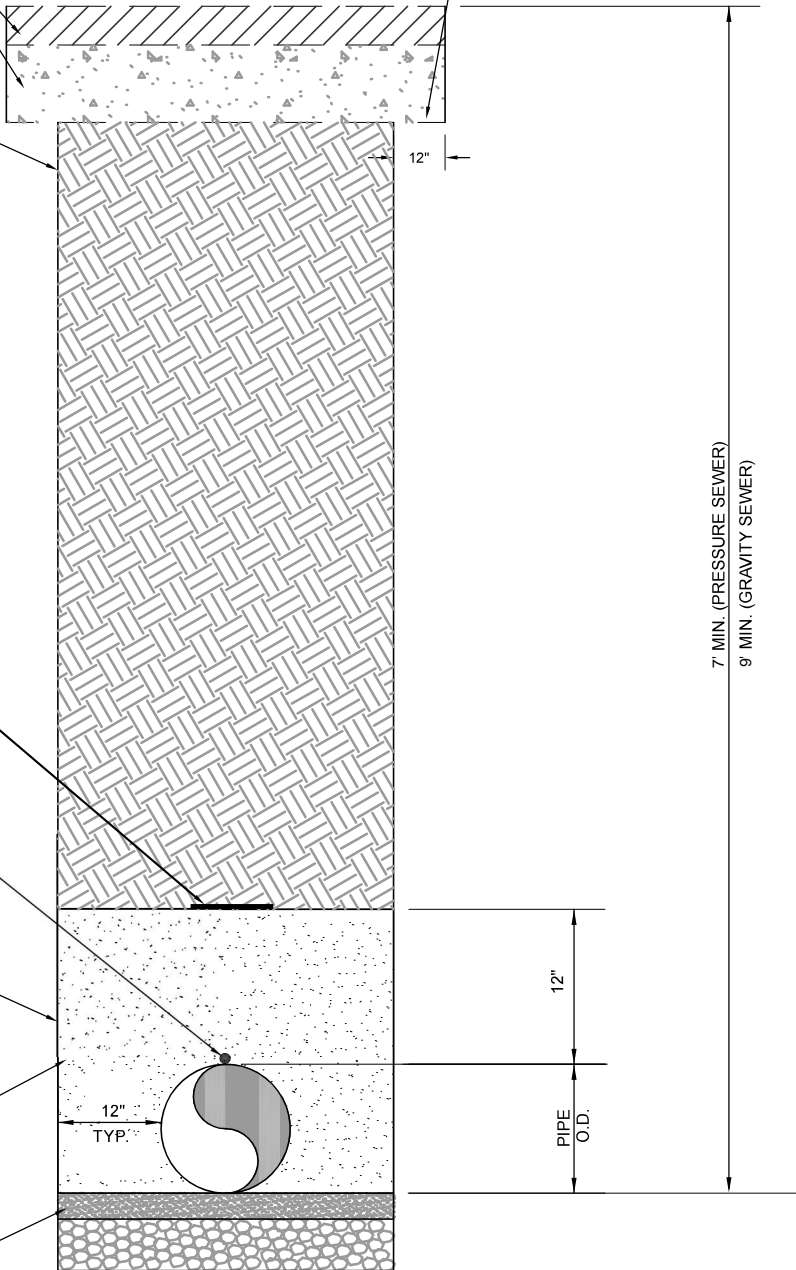

TYPICAL TRENCH DETAIL

N.T.S.

